

Installation Instructions for Emergency LED Driver



PLEASE READ CAREFULLY AND FOLLOW ALL INSTRUCTIONS FOR YOUR OWN SAFETY

WARNING:

AC power must be off before proceeding with assembly or installation of emergency driver.

CAUTION: DO NOT USE OUTDOORS.

CAUTION: DO NOT GO NEAR A FIRE OR INTO A FIRE.

CAUTION: EQUIPMENT SHOULD BE MOUNTED IN LOCATIONS AND AT HEIGHTS WHERE IT WILL NOT BE SUBJECTED TO TAMPERING BY UNAUTHORIZED PERSONNEL.

CAUTION: THE USE OF ACCESSORY EQUIPMENT NOT RECOMMENDED BY THE MANUFACTURER MAY CAUSE AN UNSAFE CONDITION.

CAUTION: DO NOT USE THIS EQUIPMENT FOR OTHER THAN ITS INTENDED USE.

CAUTION: Use with grounded, UL Listed, damp location rated fixtures and case should be grounding.


CAUTION: The equipment is intended for ordinary locations and for permanent installation into one or more listed emergency luminaires.

IMPORTANT: Please charge the battery consistently for >36 hours for the first time usage so as to activate the whole battery cells of discharging/charging duration.


IMPORTANT: The products are produced with built-in batteries, which could be stocked for one year at most without being used. If clients keep them for more than one year, the batteries may be damaged. This is not covered in the warranty.

Please read the following instructions applicable to these models.


LED-EMB-32W-HV-0/10V	100-277Vac,50/60Hz	DC120-190V 32W	Li-ion,14.4V 5.2Ah,74.88Wh	345x42x45mm	> 90minutes
----------------------	--------------------	----------------	----------------------------	-------------	-------------

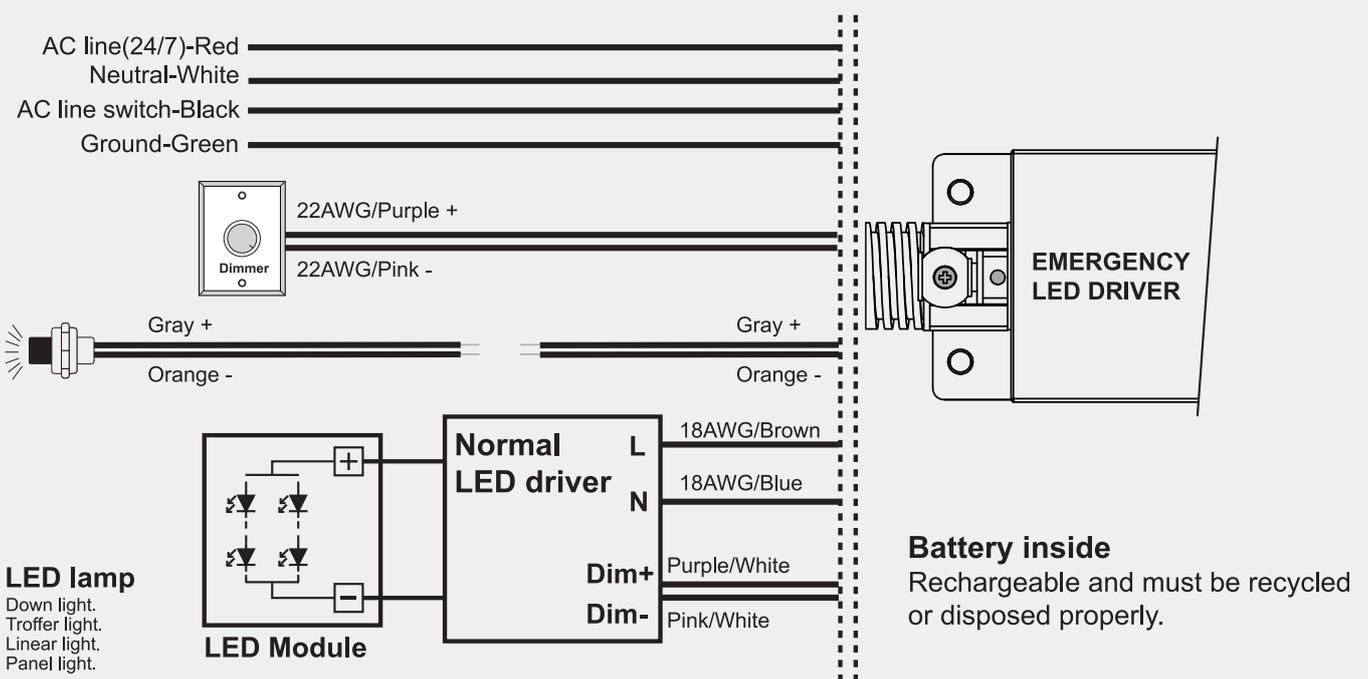

...

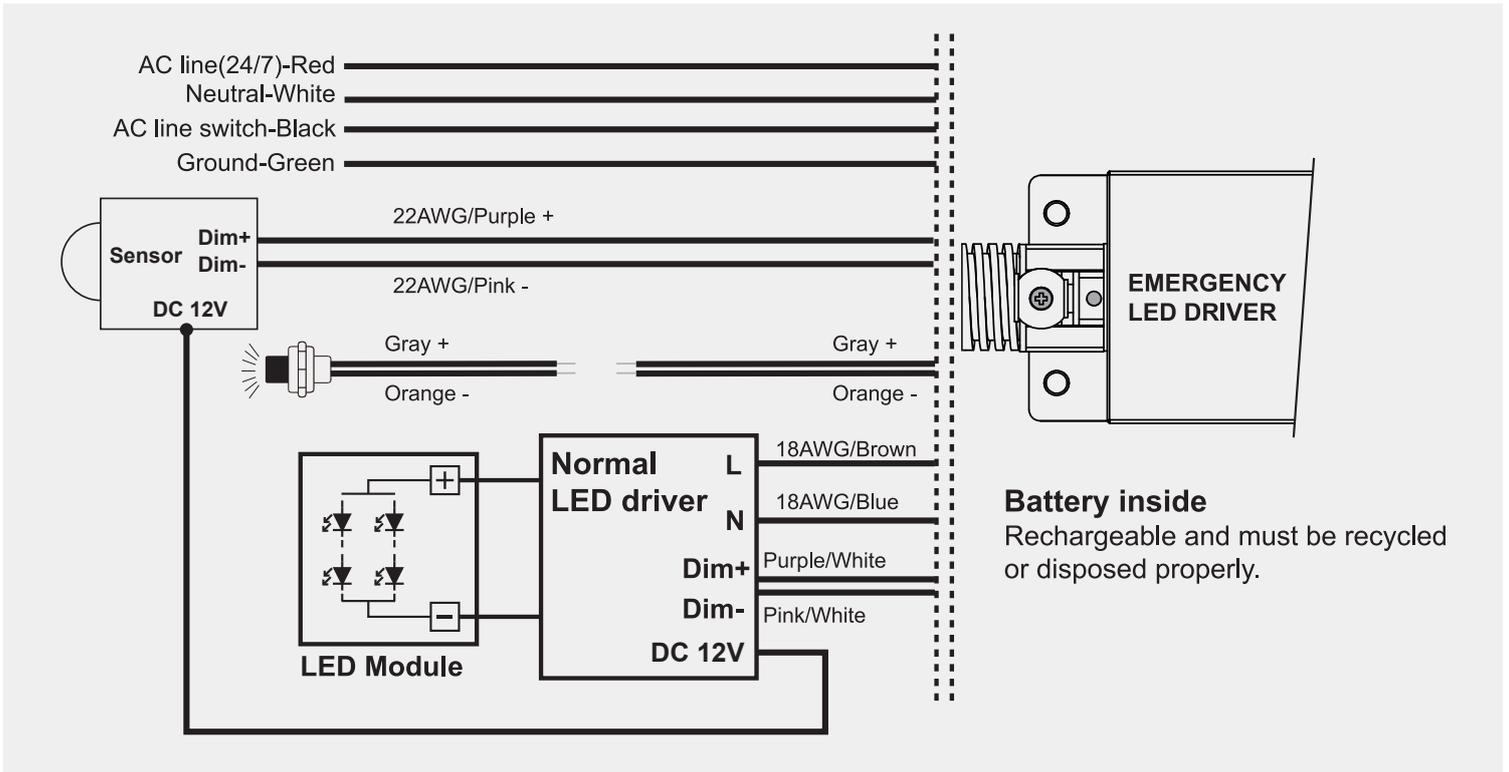

Installation dimension

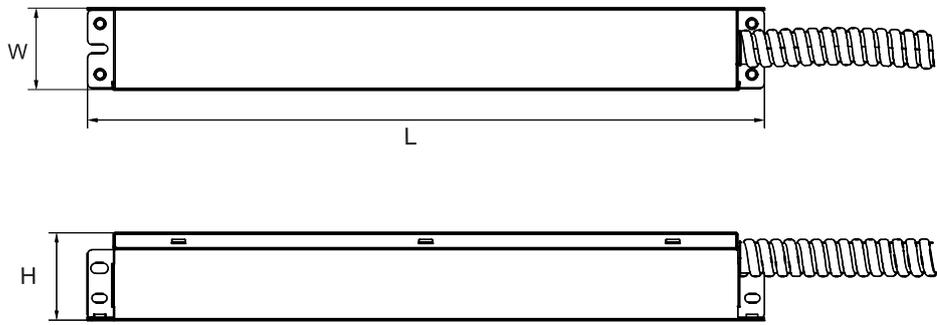

Max. mounting height: 23.7FT