

LEDVANCE

Luminaire Installation Guide

Emergency Mini Wall Pack

The Performance Class EM Mini Wall Pack luminaire offers up to 67% in energy savings. Designed for egress lighting with 600 lumens in emergency mode, this luminaire includes a test button to meet local codes. Ideal in place of traditional luminaires, or as new installations, the EM Mini Wall Pack is offered in a single wattage with three CCTs for illuminating building exteriors, outdoor corridors, walkways, and stairwells.



For warranty coverage, please register at www.ledvanceUS.com

⚠ WARNING

Please Read All Instructions Before Attempting Installation

- Do not use an electric generator to test the LED luminaire.
- Please abide by related country, regional and local law and regulations when install this fixture.
- Please don't install the fixture when raining to lower the risk of electric shock and avoid the failure.
- To avoid possibility of electrical shock or fire, the installation personnel must have professional electric knowledge.
- Please wear gloves to avoid injury before installation.
- If there is any smoke or spark, please turn off the power immediately and notify relevant personnel.
- Minimum 90°C Supply Conductors
- This product must be installed in accordance with the applicable installation code by a person familiar with the constructions and operations of the product and the hazard involved.

Safety Precautions:

IMPORTANT:

READ CAREFULLY BEFORE INSTALLING THE FIXTURE. RETAIN FOR FUTURE REFERENCE.

GENERAL:

Upon receipt of the fixture, thoroughly inspect for any freight damage which should be brought to the attention of the delivery carrier.

Color Selection Switch:


-Open fixture and adjust switch to desired CCT, color temperature




Trouble Shooting Checklist

- Check your power source.
- Check electrical connections


Installation- junction box




1. Disconnect Power




2. Loosen the four screws and remove rubber plug

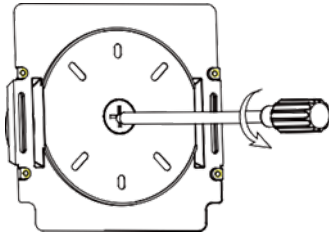


3. Remove the 1/2" end cap




4. Peel off the yellow sticker and affix it to the corresponding surface of the luminaire

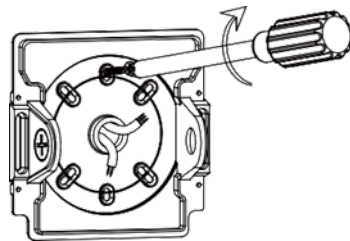


5. Remove the 1/2" end cap and pull wires through. Secure to the junction box with screws

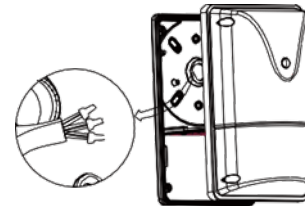

6. Attach the wires ensuring proper connections and grounding. Confirm battery connection is secure

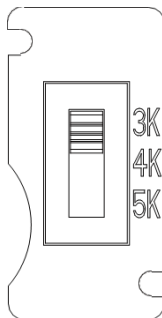


7. Select the CCT using the switch located inside the cover




8. Secure the cover with four screws

Installation



9. Reconnect the power. Confirm the emergency function works by pushing the test button

Wiring Diagram

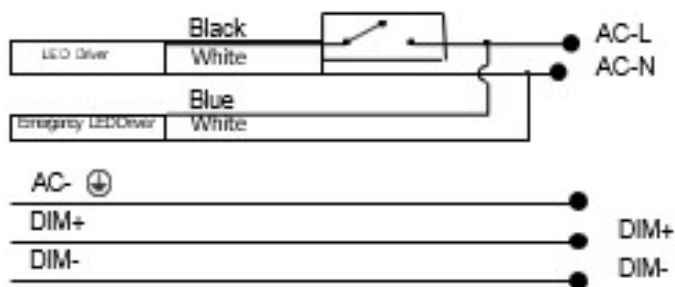

LEDVANCE

Guide d'installation des luminaires

Mini pack mural d'urgence

Les luminaires Performance Class EM Mini Wall Pack offrent jusqu'à 67 % d'économies d'énergie. Conçu pour l'éclairage de sortie de 600 lumens en mode d'urgence, ce luminaire comprend un bouton de test pour répondre aux codes locaux. Idéal à la place des luminaires traditionnels ou en tant que nouvelles installations, l'EM Mini Wall Pack est offert en une seule puissance avec trois CCT pour éclairer l'extérieur des bâtiments, les couloirs extérieurs, les allées et les cages d'escalier.



Pour obtenir la couverture de la garantie, enregistrez-vous sur
www.ledvanceus.com/warrantyregistration

AVERTISSEMENT

Veillez Lire Toutes Les Directives Avant De Commencer L'Installation

- Ne pas utiliser de génératrice pour tester les luminaires DEL
- Lors de l'installation de ce luminaire, veuillez respecter les réglementations nationales, régionales et locales
- Pour éviter le risque de choc électrique et de panne, ne pas installer sous la pluie
- Pour éviter toute possibilité de choc électrique ou d'incendie, le personnel d'installation doit avoir des connaissances professionnelles en électricité
- Veuillez porter des gants pour éviter les blessures pendant l'installation
- S'il y a présence de fumée ou d'étincelles, veuillez immédiatement couper l'alimentation et aviser le personnel concerné
- Les Fils D'Alimentation Sont De 90°C MIN
- Ce Produit Doit Être Installé selon le code D'installation pertinent par une personne qui connaît bien le produit et son fonctionnement ainsi que les risques inhérents

Measures De Precautions:

IMPORTANT: BIEN LIRE AVANT D'EFFECTUER L'INSTALLATION DU LUMINAIRE. GARDER POUR RÉFÉRENCE FUTURE.

GÉNÉRAL : lors de la réception du luminaire, inspecter le produit et s'assurer qu'aucun dommage n'est survenu pendant l'expédition, aviser immédiatement le transporteur si vous constatez des dommages.

Commutateur de sélection de la puissance


-Ouvrir le luminaire et ajuster l'interrupteur au CCT souhaité, température de couleur




Liste de vérification pour le dépannage

- Vérifier la source d'alimentation
- Vérifier les raccords électriques


Installation- boîte de jonction




1. Couper l'alimentation




2. Desserrer les 4 vis

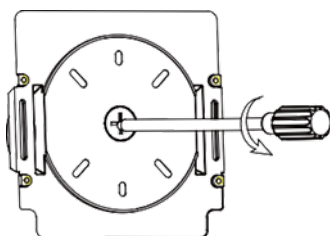


3. Retirer l'embout de 1/2 po




4. Retirer le collant jaune et le mettre sur la surface du luminaire correspondante pertinente

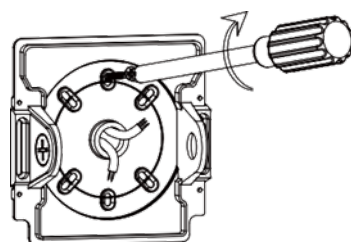


5. Retirer l'embout de 1/2 po insérer les fils. Rattacher la boîte de jonction avec les fils

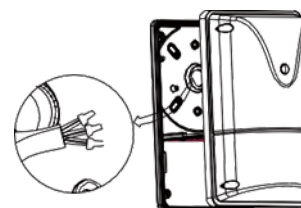

6. Rattacher les fils en s'assurant que les connexions et la mise à la terre sont adéquates.

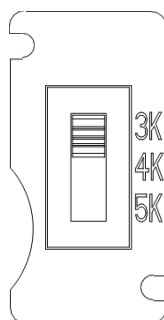


7. Choisir la TCP à l'aide de l'interrupteur situé à l'intérieur du couvercle.



8. Rattacher le couvercle avec les quatre vis

Installation- boîte de jonction



9. Rétablir l'alimentation

Schéma de câblage

