

**23W EMERGENCY LED DRIVER
LR35131****IMPORTANT SAFEGUARDS**

When using electrical equipment, basic safety precautions should always be followed, including the following:

READ AND FOLLOW ALL SAFETY INSTRUCTIONS.

CAUTION: RISK OF SHOCK-disconnect emergency and normal input power sources before servicing any equipment connected to this unit.

CAUTION: Risk of fire or electric shock-This emergency battery pack installation requires knowledge of luminaire and electrical systems.

CAUTION: Servicing of this equipment should be performed by qualified personnel only.

CAUTION: Before installation, make certain the AC power to fixture is off.

CAUTION: Verify that all replacement lamp types marked on the installed luminaire are also identified as suitable for use with this emergency battery pack.

CAUTION: Suitable for use in 5°C - 60°C ambient temperatures.

IMPORTANT: An unswitched AC power source is required (100-277V AC, 50/60 Hz). This device is designed for fixtures listed for dry and damp locations.

IMPORTANT: Customers are advised to charge emergency LED driver 24 hours every 6 months during storage.

IMPORTANT: Lighting fixture manufacturers, electricians, and end-users need to ensure product system compatibility test before using and final installation.

CAUTION: Do not use outdoors. Do not mount near gas or electric heaters.

CAUTION: Equipment should be mounted in locations and at heights where it will not be subjected to tampering by unauthorized personnel.

CAUTION: The use of accessory equipment is not recommended by the manufacturer may cause an unsafe condition.

CAUTION: The emergency battery pack is not for in an air-handling fixture.

CAUTION: Do not use this equipment for other than its intended use.

TESTING SYSTEM: The emergency battery requires a charge minimum of one (1) hour before testing the circuit. A full charge requires twenty-four (24) hours



THIS PRODUCT CONTAINS A RECHARGEABLE LiFePO4 BATTERY.
THE BATTERY MUST BE RECYCLED OR DISPOSED OFF PROPERLY.


OPERATION

Normal Mode: AC power is present. The AC driver operates the LED load as designed. The emergency driver is charging in a standby mode. The charging indicator light is red, showing that the battery is charging.

Emergency Mode: When the AC power goes out, the emergency driver detects the AC power outage and automatically switch to emergency mode. The LED luminaire is illuminated for a minimum of 90 minutes. When the AC power is restored, the emergency driver switches the system back to the Normal Mode and resumes battery charging.





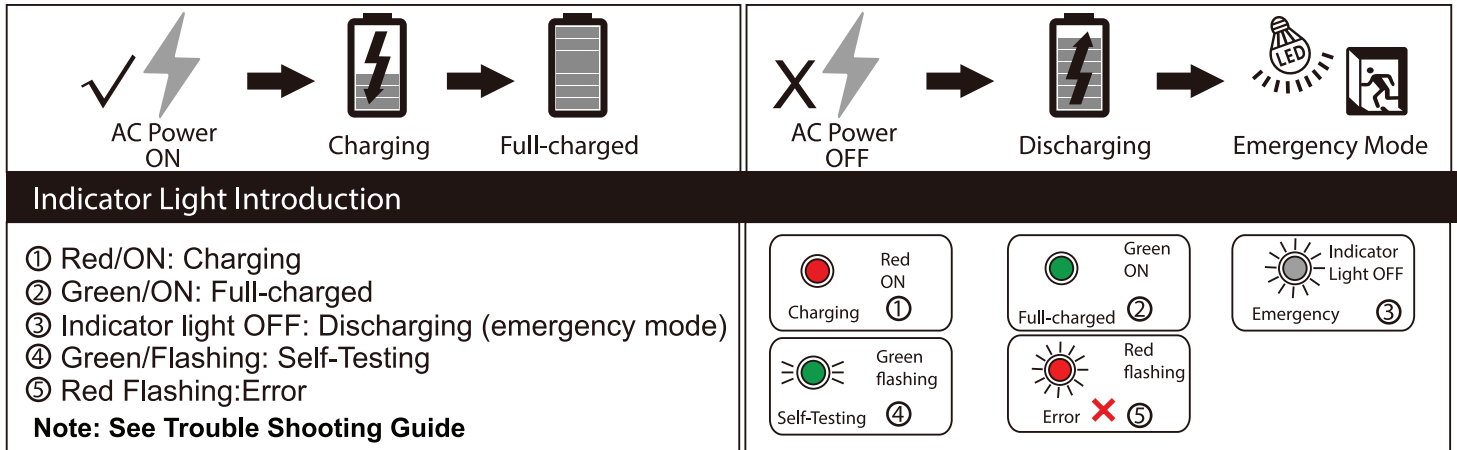









SELF-TEST:

This unit contains a control/monitor circuit that if enabled automatically performs a 30-second discharge test once a month and a full 90-minute discharge test once a year. During routine testing, the self-testing emergency driver simulates an AC power failure causing the unit to automatically switch to emergency mode. The unit will monitor the operation of the LED load, battery voltage, and emergency duration. If the emergency system functions properly, then the unit will return to normal mode. Should the unit detect any problems, the indicator light will flash per failure condition (see Troubleshooting Guide) until the condition has been corrected and the unit passes the next test.



TEST SWITCH INDICATOR STATUS & TROUBLE SHOOTING GUIDE


The charge indicator will be lit Solid Red when charging, and will be lit Solid Green when fully charged and in the standby mode. The indicator will flash Green when self-testing. If a problem is encountered during the test cycle, the indicator will flash Red, according to the diagnostic codes below:

Mode	LED Indicators Status	Error	EM Driver Status / Mode	Corrective Action
Normal Mode	Solid Green 	None	Battery fully charged/System OK	/
	Solid Red 	None	Battery is charging	/
	None.Both LEDs OFF 	None	In EM mode or emergency run-time is ended	/
	Flashing Green, 1s ON/ 1s OFF 	None	Self-Diagnostic test underway	/
Fault Mode	Very slow Flashing Red, 0.5s On / 0.5s Off 	LED Load	1. LED output load is short / Over Current/Over Voltage/Open load/ OCP in EM Mode. 2. Output circuit failure in EM mode.	Check for Open or Short circuit on the output connections.
	Red Flashing×2  	Charging	/	1. Check input AC mains wiring of Unswitched Hot, Neutral and Ground. 2. Verify Voltage and Frequency are stable and match the input rating.
	Red Flashing×3   	Battery	Battery failure Battery not connected	Replace battery check battery switch or connection.
	Red Fast Flashing×4    	Battery	Indicates that a self-test / self-diagnostic test did not meet full duration	1. Charge the unit for the rated recharge time and perform a manual self- diagnostic test. 2. If error is still present replace battery.

MANUAL TEST

- **Initial Testing** – Quick discharge test: Press the Test button 1 time to simulate emergency mode; LED load will light up for 5 seconds
- **Monthly** – 30-second test: Press the Test button 3 seconds continuously can conduct a monthly test; LED load will light up for 30 seconds.
- **Annually** – 90-minute test: Press the Test button 6 seconds continuously can conduct an annual test; LED load will light up for 90 minutes.
- During Emergency Mode, Press and hold test switch 6 seconds can to cut off the emergency output and enter Shipping Mode.
- **Note:** during any manual test, press and hold the Test Button/Test Switch for 1 second to terminate a manual test.

WIRING DIAGRAM


 **CAUTION:** Before installing, make certain the AC power is off.

ATTENTION:




1. NOTE: PLEASE PRESS TEST BUTTON TWICE TO MAKE CERTAIN THE BATTERY IS TURNED OFF, BEFORE INSTALLATION, MAINTENANCE, STORAGE OR SHIPPING.
2. DO NOT MATE UNIT CONNECTOR UNTIL INSTALLATION IS COMPLETE.
3. FULL EMERGENCY POWER, THE LAMP POWER MUST BE LESS THAN THE EMERGENCY POWER.


1 For Type B Double-ended LED Tube ≤ 23W

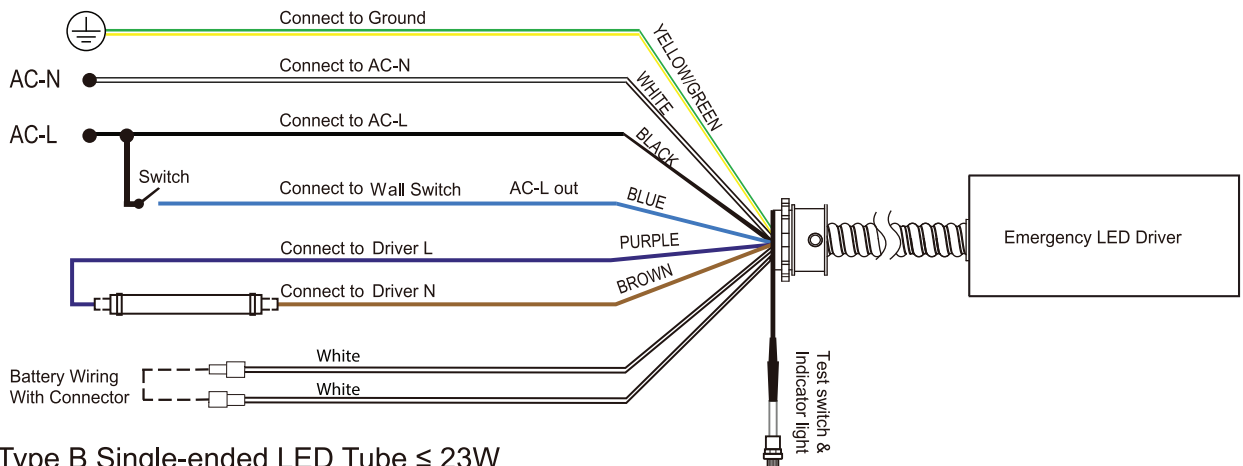


2 For Type B Single-ended LED Tube ≤ 23W

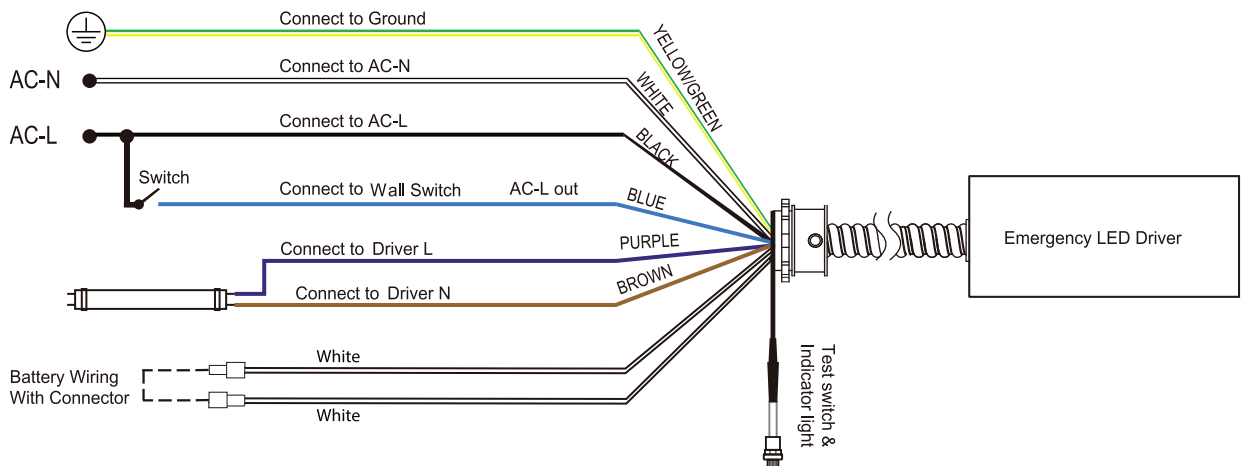

3 For Type A LED Tube ≤ 23W

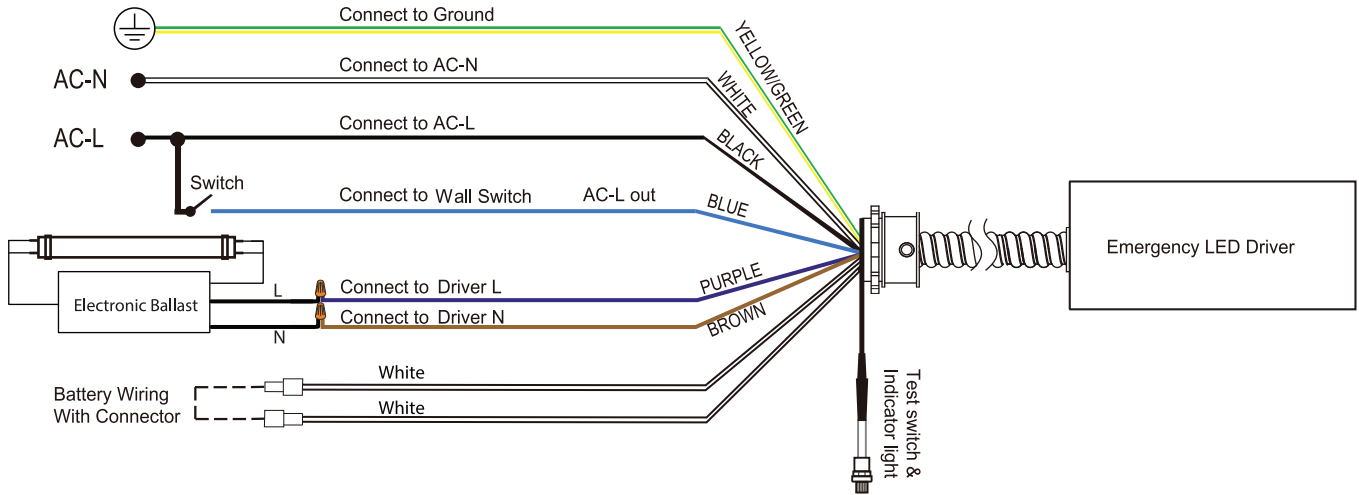

4 For LED lights ≤ 23W, without using Triac Dimmer

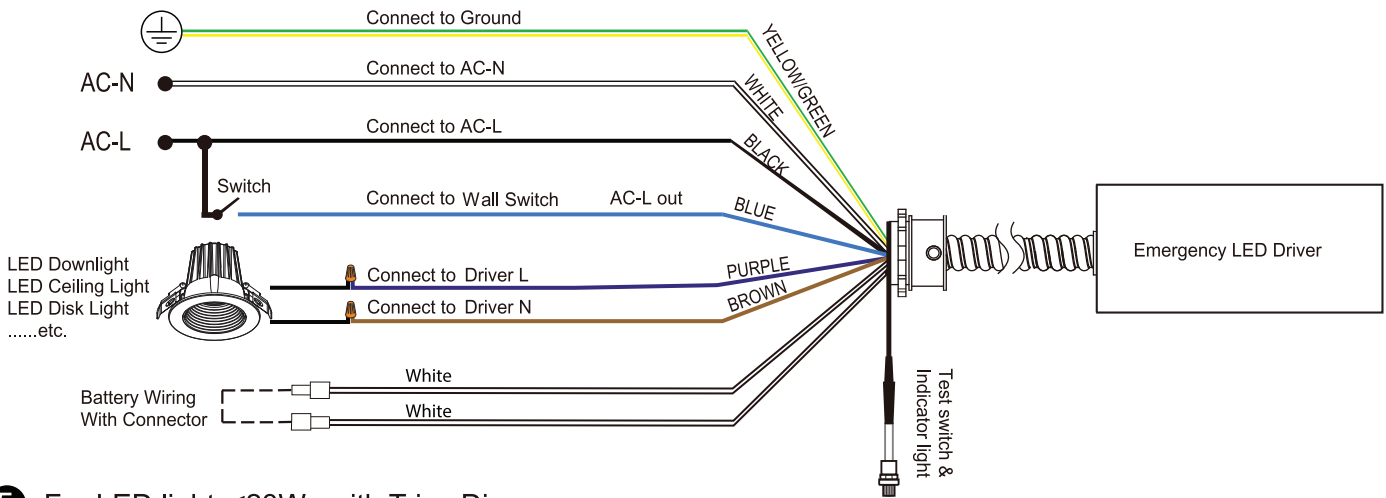

5 For LED lights ≤ 23W, with Triac Dimmer

